

DEPARTMENT OF PERMITTING, ENVIRONMENT, AND REGULATORY AFFAIRS (PERA)

BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY PRODUCT CONTROL SECTION

11805 SW 26 Street, Room 208 Miami, Florida 33175-2474 T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/pera/

Air Balance Incorporated 450 Riverside Drive Wyalusing, PA 18853

Scope: This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County PERA -Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. PERA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Model A-520 5" deep Aluminum Louver

APPROVAL DOCUMENT: Drawing No. 1686, titled "A-520 Impact Louver System", sheets 1 through 10 of 10, dated 07/23/2009, with revision A1 dated 11/08/2011, prepared by W. W. Schaefer Engineering & Consulting, P.A., signed and sealed by Warren. W. Schaefer, P.E., bearing the Miami-Dade County Product Control revision stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA revises NOA # 09-1015.11 and consists of this page 1 and evidence page E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by Carlos M. Utrera, P.E.

MIAMI-DADE COUNTY APPROVED

03/01/2012

NOA No. 12-0105.02 Expiration Date: January 06, 2015 Approval Date: March 8, 2012

Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No. 1686, titled "A-520 Impact Louver System", sheets 1 through 10 of 10, dated 07/23/2009, with revision A1 dated 11/08/2011, prepared by W. W. Schaefer Engineering & Consulting, P.A., signed and sealed by Warren W. Schaefer, P.E.

B. TESTS "Submitted under NOA # 09-1015.09"

- 1. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 2) Large Missile Impact Test per FBC, TAS 201-94
 - 3) Cyclic Wind Pressure Loading per FBC, TAS 203-94

along with marked-up drawings and installation diagram, of "EA-52 Aluminum Louver Systems", prepared by Hurricane Test Laboratory, Inc., Report No. **0198-0305-09**, dated 09/29/2009, signed and sealed by Vinu J. Abraham, P.E.

- 2. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 2) Large Missile Impact Test per FBC, TAS 201-94
 - 3) Cyclic Wind Pressure Loading per FBC, TAS 203-94

along with marked-up drawings and installation diagram, of "EA-52 Aluminum Louver Systems", prepared by Hurricane Test Laboratory, Inc., Report No. 0198-0715-09, dated 09/30/2009, signed and sealed by Vinu J. Abraham, P.E.

C. CALCULATIONS "Submitted under NOA # 09-1015.09"

1. Structural calculations prepared by W.W. Schaefer Engineering & Consulting, P.A., dated 10/06/2009, signed and sealed by Warren W. Schaefer, P.E.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Permitting, Environment, and Regulatory Affairs (PERA)

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS

- 1. Statement letter of code conformance to 2007 and 2010 FBC issued by W. W. Schaefer Engineering & Consulting, P.A., dated 11/08/2011, signed and sealed by Warren W. Schaefer, P.E.
- 2. No financial interest letter issued by W. W. Schaefer Engineering & Consulting, P.A, dated 11/08/2011, signed and sealed by Warren W. Schaefer, P.E.
- 3. Private label agreement dated 12/21/2011.


"Submitted under NOA # 09-1015,09"

4. Code compliance letters issued by Hurricane Test Laboratory, Inc., dated 09/29/2003 and 09/30/2009, signed and sealed by Vinu J. Abraham, P.E.

Carlos M. Utrera, P.E. Product Control Examiner NOA No. 12-0105.02

Expiration Date: January 06, 2015

Approval Date: March 8, 2012

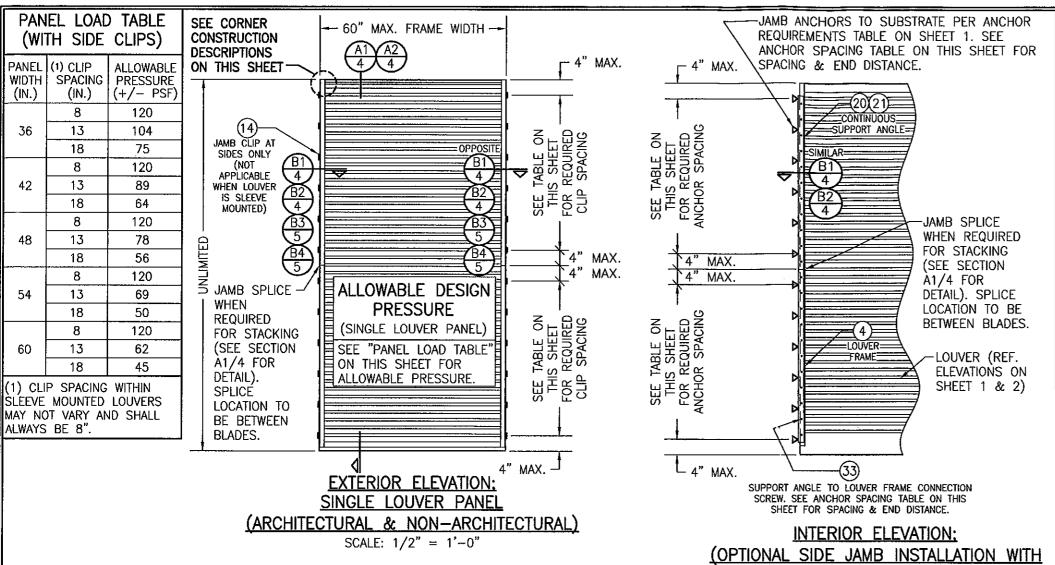

CONTINUOUS SIDE ANGLES)

SCALE: 1/2" = 1'-0"

(FOR DETAIL NOT SHOWN, SEE OTHER ELEVATIONS)

GENERAL NOTES:

1. THESE LOUVER SYSTEMS HAVE BEEN TESTED, ANALYZED & APPROVED FOR DESIGN PRESSURES NOT TO EXCEED

THOSE SHOWN IN THE "ALLOWABLE DESIGN PRESSURE TABLE(S).

2. OPENINGS, BUCKING & BUCKING FASTENERS MUST BE PROPERLY DESIGNED & INSTALLED TO TRANSFER WIND LOADS TO THE STRUCTURE. IT SHALL BE THE RESPONSIBILITY OF THE PERMIT HOLDER TO VERIFY THE STRUCTURAL INTEGRITY OF THE EXISTING STRUCTURE TO SUPPORT THE LOADS SUPERIMPOSED BY THE LOUVERS.

ALL HARDWARE & FASTENERS SHALL BE IN ACCORDANCE WITH THESE DRAWINGS & SHALL NOT VARY UNLESS SPECIFICALLY MENTIONED ON THE DRAWINGS. SPECIFIED ANCHOR EMBED TO BASE MATERIAL SHALL BE BEYOND WALL FINISH OR STUCCO.

4. THE DETAILS & SPECIFICATIONS SHOWN HEREIN REPRESENT THE PRODUCTS TESTED & PROPOSED FOR IMPACT. CYCLIC & UNIFORM STATIC AIR PRESSURE TESTING IN CONFORMANCE WITH THE FLORIDA BUILDING CODE PROTOCALS TAS-201, 202 & 203 FOR LARGE MISSILE IMPACT LOUVERS.

5. THESE LOUVER SYSTEMS HAVE BEEN DESIGNED IN ACCORDANCE WITH AND MEET THE REQUIREMENTS OF THE FLORIDA BUILDING CODE (FBC) INCLUDING HIGH VELOCITY HURRICANE ZONES (HVHZ).

IMPACT SHUTTERS ARE NOT REQUIRED WITH THESE LOUVER SYSTEMS. ALL ANCHORS SECURING LOUVER FRAME TO PRESSURE TREATED BUCKS OR WOOD FRAMING SHALL BE CAPABLE OF

RESISTING CORROSION CAUSED BY THE PRESSURE TREATING CHEMICALS IN THE WOOD.

8. DETERMINE THE POSITIVE & NEGATIVE DESIGN LOADS TO USE WHEN REFERENCING THESE DOCUMENTS IN ACCORDANCE WITH THE GOVERNING CODE AND GOVERNING WIND VELOCITY. FOR WIND LOAD CALCULATIONS IN ACCORDANCE WITH THE FLORIDA BUILDING CODE, A DIRECTIONALITY FACTOR OF Kd = 0.85 MAY BE APPLIED PER THE ASCE-7 STANDARD.

9. NO INCREASE IN ALLOWABLE STRESS HAS BEEN USED IN THE CERTIFICATION OF THIS PRODUCT. WIND LOAD DURATION FACTOR Cd = 1.6 WAS USED FOR WOOD SCREW ANALYSIS ONLY.

10. MATERIALS, INCLUDING BUT NOT LIMITED TO STEEL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF FLORIDA BUILDING CODE CHAPTER 20.

11. EACH LOUVER ASSEMBLY SHALL BE PERMANENTLY LABELED AS FOLLOWS:

AIR BALANCE INC.

WYALUSING, PA

MIAMI-DADE COUNTY PRODUCT CONTROL APPROVED

12. THESE LOUVERS ARE NOT TESTED FOR WATER INFILTRATION RESISTANCE. THEREFORE THE LOUVERS ARE TO BE INSTALLED IN A LOCATION WHERE THE ROOM BEHIND THE LOUVER IS DESIGNED TO DRAIN WATER PENETRATING INTO THE ROOM, AND THE ROOM WILL HOUSE WATER RESISTANT/WATER PROOF EQUIPMENT, COMPONENTS OR SUPPLIES. 13. MULLED PANELS MAY BE HORIZONTALLY INSTALLED TO AN UNLIMITED NUMBER. VERTICAL STACKING OF MULLED PANELS MAY OCCUR PROVIDING A STRUCTURAL SUPPORT IS DESIGNED & INSTALLED BY OTHERS TO SUPPORT ALL LOADS TRANSFERED FROM THE LOUVER ASSEMBLY (SINGLE PANELS MAY RUN TO UNLIMITED HEIGHT PER ELEVATION IF NO MULLION EXISTS).

ANCI	HOR REQUIREMENTS TABLE				
OPENING TYPE (SUBSTRATE)	FRAME CLIP TO OPENING FASTENER TYPE	MINIMUM EMBED	MINIMUM EDGE DIST.		
JAMB & NON-REINFORCED MULLION END CLIP ANCHORS					
MIN. 2X_ WOOD FRAME OR BUCK (MIN. GR. 3 & G=0.55)	NO, 14 SMS OR WOOD SCREW	1 3/8"	3/4"		
MIN. 16 GA. 33 KSI METAL STUD	1/4-14 GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"		
MIN. 1/8" THK A36 STEEL	1/4-14 GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"		
MIN. 1/8" THK 6063T5 ALUM.	1/4-14 GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"		
(3) MIN. C-90 CMU	(1) 1/4" CONCRETE SCREW	1 1/4"	2"		
MIN. 3000 PSI CONCRETE	(1) 1/4" CONCRETE SCREW	1 1/2"	2"		
TUBE MULLION END CLIP ANCHORS					
MIN. 2X_ WOOD FRAME OR BUCK (MIN. GR. 3 & G=0.55)	NO. 14 SMS OR WOOD SCREW	1 3/8"	3/4"		
MIN. 16 GA. 33 KSI METAL STUD	1/4-14 GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"		
MIN. 1/8" THK A36 STEEL	1/4-14 GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"		
MIN. 1/8" THK 6063-T5 ALUM.	1/4-14 GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"		
3000 PSI CONCRETE	(2) 1/2" WEDGE ANCHOR	3 1/2"	3"		
(1) CONCRETE SCREWS SHALL BE	FLCO LILTRACONS ITW RAMSET/RED HE	AD TAPCO	NS OR		

(1) CONCRETE SCREWS SHALL BE ELCO ULTRACONS, ITW RAMSET/RED HEAD TAPCONS OR HILTI KWIK-CON II (HARDENED STEEL OR S.S.). (2) WEDGE ANCHORS SHALL BE HILTI STAINLESS STEEL KWIK BOLT 3

(3) CMU IS APPLICABLE AT SIDES ONLY.

	(WITH CONTINUOUS SIDE SUPPORT ANGLE)					W.R.M. PLOT: 1=24			
	PANEL	ANGL		ANGLE TO	LOUVER	ALLOWABLE PRESSURE	DATE	11/08/11	
	WIDTH (IN.)	SPACING (IN.)	END DIST. (IN.)	SPACING (IN.)	END DIST. (IN.)	(+/- PSF)		W.R.M. 11	
		8	4	4	2	120	ě,	¥	
	36	13	7 1/2	7 1/2	3 3/4	104	z		
		18	9	9	4 1/2	75	DESCRIPTION	جة دي	SESSION N
	42	8	4	4	2	120	ESC	¥	ADE.
		13	7 1/2	7 1/2	3 3/4	89		CONSULTANTS	EE
		18	9	9	4 1/2	64	REVISION		퉏
		8"	4	4	2	120	씯	UPDATE	MANUFACTURERS ADDRESS
		13	7 1/2	7 1/2	3 3/4	78	Š	١٧	Ë
		18	9	9	4 1/2	56			Г
	54	8	4	4	2	120			
		13	7 1/2	7 1/2	3 3/4	69			l
		18	9	9	4 1/2	50			
	60	8	4	4	2	120			
		13	7 1/2	7 1/2	3 3/4	62			
		18	9	9	4 1/2	45			

PANEL ANCHOR SPACING/PRESSURE TABLE

NOTE: SINGLE LOUVER PANELS MAY BE STACKED/SPLICED VERTICALLY OR THE LOUVER PANEL MAY RUN VERTICALLY TO INFINITE HEIGHT PROVIDING OPENING IS PROPERLY DESIGNED BY OTHERS TO SUPPORT THE LOUVER PANELS.

SLEEVE SPLICING NOTE FOR SLEEVE MOUNTED LOUVERS:

SLEEVE MAY BE SPLICED ALONG HORIZONTAL OR VERTICAL RUNS PROVIDING SPLICE DOES NOT OCCUR WITHIN 12" OF ANY VERTICAL MULLION CENTERLINE.

CORNER & BLADE END CONSTRUCTION:

PRODUCT REVISED

Building Code

Acceptance No 12

as complying with the Florida

FRAME_HEAD: HORIZONTAL MEMBER IS SQUARE CUT, BUTTED TO VERTICAL MEMBERS & FASTENED WITH TWO(2) NO. 7 X 1 1/4" SMS HEX HEAD SCREWS INTO THE HORIZONTAL MEMBERS SCREW

FRAME SILL: VERTICAL MEMBERS ARE ANGLE CUT, BUTTED TO HORIZONTAL MEMBER & FASTENED WITH TWO(2) NO. 7 X 1 1/4" SMS SCREWS INTO THE VERTICAL MEMBERS SCREW SPLINES. BLADE END; HORIZONTAL BLADES ARE SQUARE CUT, BUTTED TO VERTICAL MEMBERS & FASTENED WITH TWO(2) NO. 7 OR NO. 8 X 1 1/4" SMS SCREWS INTO THE BLADE SCREW SPLINES.

> SUPER * HEAVE ડ **≥ંન્ડ** HEFER # 437N 2011 44135 CICENS THESE DRAWINGS ARE APPLICABLE ONLY TO THE PRODUCT SPECIFIED. THEY MAY NOT BE USED FOR THE ASSEMBLY AND/OR INSTALLATION OF ANY OTHER PRODUCT NOR MAY 00 Expiration Date 0110612015 1686 AND/OR INSTALLATION OF ANY OTHER PRODUCT NOR MAY THEY BE USED FOR RATIONAL AND/OR LOCAL APPROVAL OF ANY PRODUCT NOT PRODUCED BY THE MANUFACTURES SHEET NO. OF

HECKED BY

ATE: 07/23/09

DRIV 1889 1888

450 RIVERSIDE WYALUSING, PA 570-746-18

BALANCE

ENGINEERING P.A. (CA 6809)

SCHAEFER NSULTING, F

SYSTEM

LOUVER

IMPACT

A520

W.W.S.


W.R.M.

(NON-ARCHITECTURAL LOUVERS)						
MAXIMUM MULLION	MAXIMUM LOAD	ALLOWABLE PRESSURE (+/- PSF)				
SPAN (IN.)	WIDTH (IN.)	WITH NO TUBE MULLION	WITH 4"X3"X3/16" TUBE MULLION	WITH 4"X3"X1/4" TUBE MULLION		
	60	30.6	46.1	61.4		
	54	34.0	51.2	68.3		
	48	38.3	57.6	76.8		
120	42	43.7	65.8	87.8		
120	36	51.0	76.8	102.4		
	30	61.2	92.2	120.0		
	24	76.5	115.2	120.0		
	18	102.0	120.0	120.0		
	60	42.0	63.2	84.3		
	54	46.6	70.2	93.6		
405	48	52.5	79.0	105.3		
108	42	60.0	90.3	120.0		
	36	70.0	105.3	120.0		
	30	84.0	120.0	120.0		
	24	104.9	120.0	120.0		
	18	120.0	120.0	120.0		
	60	56.3	90.0	120.0		
	54	62.5	100.0	120.0		
) 1	48	70.3	112.5	120.0		
96	42	80.4	120.0	120.0		
1	36	93.8	120.0	120.0		
•	30	112.5	120.0	120.0		
1	24	120.0	120.0	120.0		
	60	64.3	120.0	120.0		
	54	71.4	120.0	120.0		
84	48	80.4	120.0	120.0		
Ŭ. <u> </u>	42	91.8	120.0	120.0		
ļ	36	107.1	120.0	120.0		
	30	120.0	120.0	120.0		
]	60	75.0	120.0	120.0		
ļ	54	83.3	120.0	120.0		
72	48	93.8	120.0	120.0		
72	42	107.1	120.0	120.0		
	36	120.0	120.0	120.0		
	60	90.0	120.0	120.0		
60	54	100.0	120.0	120.0		
60	48	112.5	120.0	120.0		
	42	120.0	120.0	120.0		
48	60	112.5	120.0	120.0		
	54	120.0	120.0	120.0		
42	60	120.0	120.0	120.0		


MULLION ALLOWABLE DESIGN PRESSURE

1. SEE ELEVATION FOR DIMENSIONING OF LOAD WIDTH.

2. ALLOWABLE UNIT PRESSURE SHALL BE THE LESSER OF THE PRESSURE SHOWN IN THIS TABLE & THAT SPECIFIED FOR THE INDIVIDUAL LOUVER PANEL.

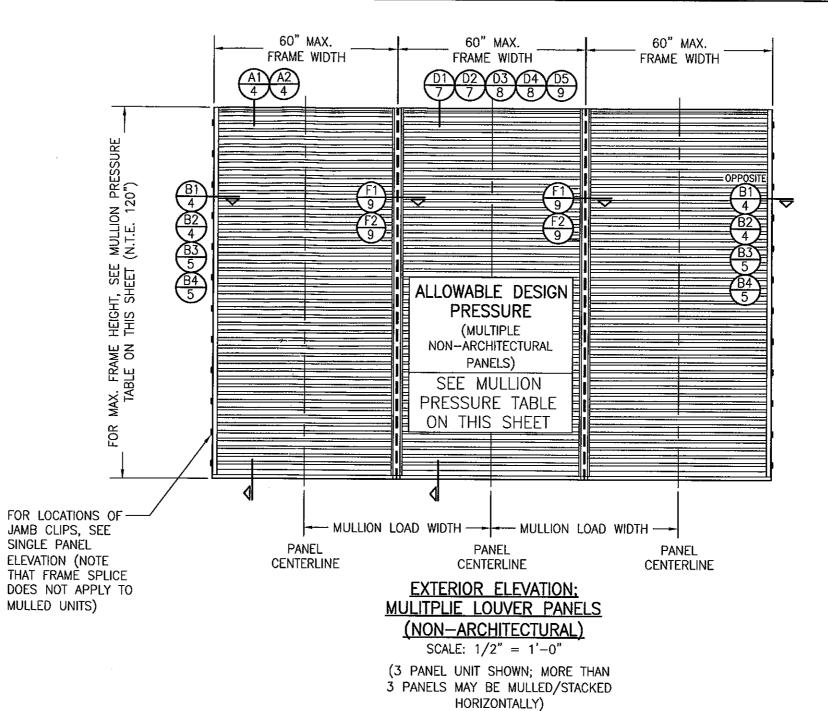

PRODUCT REVISED

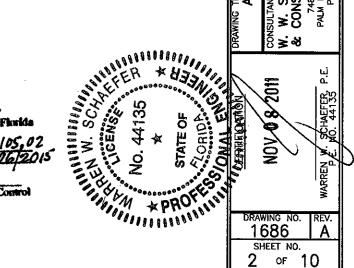

SYSTEM

LOUVER

IMPACT

RAWN BY

CHECKED BY OATE: 07/23/09


MULLION ALLOWABLE DESIGN PRESSURE (ARCHITECTURAL LOUVERS)

MAXIMUM MULLION SPAN (IN.)	MAXIMUM LOAD WIDTH (IN.)	ALLOWABLE PRESSURE (+/- PSF)			
120	60	61.4			
	54	68.3			
	48	76.8			
	42	87.8			
	36	102.4			
	30	120.0			
108	60	84.3			
	54	93.6			
	48	105.3			
	42	120.0			
96	60	120.0			

NOTES

1. SEE ELEVATION FOR DIMENSIONING OF LOAD WIDTH.

2. ALLOWABLE UNIT PRESSURE SHALL BE THE LESSER OF THE PRESSURE SHOWN IN THIS TABLE & THAT SPECIFIED FOR THE INDIVIDUAL LOUVER PANEL.

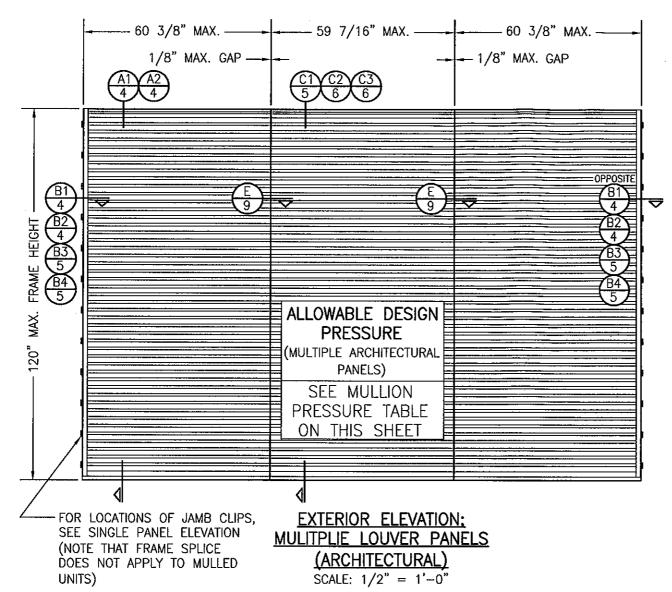

(3 PANEL UNIT SHOWN; MORE THAN 3 PANELS MAY BE MULLED/STACKED HORIZONTALLY)

POLICE NO. 44 135 W. SCA.

PROWING THE CONSULT CO

3 of 10

SYSTEM

LOUVER

A520 IMPACT

PLOT: 1=24 DATE: 07/23/09

AIR BALANCE INC.
450 RIVERSIDE DRIVE
WYALUSING, PA 18853
570-746-1888

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 12-0105.0
Expiration Date 01/06/20

By France Miama Dide Product Control

